

PART 5 - APPENDICIES

This page intentionally left blank.

**APPENDIX A - SUPPLEMENTAL BIDDER RESPONSIBILITY
CRITERIA**

APPENDIX A - SUPPLEMENTAL BIDDER RESPONSIBILITY CRITERIA FORMS

CANAL VIEW MAINLINE IMPROVEMENTS

These forms shall be completed in their entirety and submitted by the apparent two lowest Bidders to the Mason County PUD No. 1 by 12:00 p.m. (noon) of the second business day following the bid submittal deadline.

Failure to submit and meet the requirements as stated in Section 2.01.8 of the General Conditions shall be grounds for rejection of the bid. The Mason County PUD No. 1 will be the sole judge in determining if the prospective contractor meets the minimum experience requirements.

Contractor:

Name: _____

Address: _____

Phone: _____

Contact Person: _____

1. Delinquent State Taxes

Instructions to Bidders: Check the appropriate box

☐ The Bidder does not owe delinquent taxes to the Washington State Department of Revenue.

☐ Alternatively, the Bidder does owe delinquent taxes to the Washington State Department of Revenue.

If the Bidder owes delinquent taxes, they must submit a written payment plan approved by the Department of Revenue, to the Contracting Agency.

(Date)

(Signature)

(Print Name)

(Title)

2. Claims Against Retainage and Bonds:

Instructions to Bidders: Check the appropriate box

☐ The Bidder has not had claims against retainage and bonds in the 3 years prior to the bid submittal date.

☐ Alternatively, the Bidder has had claims against retainage and bonds in the 3 years prior to the bid submittal date.

If the Bidder has had claims against retainage and bonds in the 3 years prior to the bid submittal date, submit a list of public works projects completed during this period that have had claims against retainage and bonds and include name of Project, contact information for the Owner, a list of claims filed against retainage and/or payment bond for any of the projects listed; and a written explanation of circumstances surrounding each claim and the ultimate resolution of the claim.

(Date)

(Signature)

(Print Name)

(Title)

3. Public Bidding Crime:

Instructions to Bidders: Check the appropriate box

☐ The undersigned certifies that the Bidder and/or its Owners have not been convicted of a crime involving bidding on a public works contract in the 5 years prior to the bid submittal date.

☐ Alternatively, the undersigned confirms that the Bidder and/or its Owners have been convicted of a crime involving bidding on a public works contract in the 5 years prior to the bid submittal date.

If the Bidder and/or its Owners have been convicted of a crime involving bidding on a public works contract, provide a written explanation identifying the date of the conviction and a description of the circumstances surrounding the conviction.

(Date)

(Signature)

(Print Name)

(Title)

4. Termination for Cause/Termination for Default

Instructions to Bidders: Check the appropriate box

☐ The undersigned certifies that the Bidder has not had any public works contracts terminated for cause or terminated for default by a government agency in the 5 years prior to the bid submittal date.

☐ Alternatively, the undersigned confirms that the Bidder has had public works contracts terminated for cause or terminated for default by a government agency in the 5 years prior to the bid submittal date.

If the Bidder has had any public works contracts terminated for cause or terminated for default in the 5 years prior to the bid submittal date, provide a written explanation for all contracts terminated for cause or terminated for default by identifying the project contract that was terminated, the government agency which terminated the Contract, the date of the termination, and a description of the circumstances surrounding the termination.

(Date)

(Signature)

(Print Name)

(Title)

5. Lawsuits

Instructions to Bidders: Check the appropriate box

☐ The undersigned certifies that the Bidder has not had any lawsuits with judgments entered against the Bidder in the 5 years prior to the bid submittal date that demonstrate a pattern of failing to meet the terms of contracts.

☐ Alternatively, the undersigned confirms that the Bidder has had any lawsuits with judgments entered against the Bidder in the 5 years prior to the bid submittal date that demonstrate a pattern of failing to meet the terms of contracts.

If the Bidder has had any lawsuits with judgments entered against the Bidder in the 5 years prior to the bid submittal date that demonstrate a pattern of failing to meet the terms of contracts, submit a list of lawsuits along with a written explanation of the circumstances surrounding each lawsuit. The Contracting Agency shall evaluate these explanations to determine whether the lawsuits demonstrate a pattern of failing to meet the terms of contracts.

(Date)

(Signature)

(Print Name)

(Title)

6. Contract Time (Liquidated Damages)

Instructions to Bidders: Check the appropriate box

☐ The undersigned certifies that the Bidder has not had liquidated damages assessed on any project it has completed in the 5 years prior to the bid submittal date.

☐ Alternatively, the undersigned confirms that the Bidder has had liquidated damages assessed on projects in the 5 years prior to the bid submittal date.

If the Bidder has had liquidated damages assessed against projects in the 5 years prior to the bid submittal date, submit a list of projects along with Owner contact information, and number of days assessed liquidated damages. The Contracting Agency shall determine whether the Contractor has a pattern of failing to complete projects within Contract Time.

(Date)

(Signature)

(Print Name)

(Title)

7. Capacity and Experience

The Bidder shall have sufficient current capacity and the Project Superintendent assigned to the Project shall have experience to meet the requirements of this Project. The Bidder and Project Superintendent shall have successfully completed at least two projects as the prime contractor, of a similar size and scope, during the 5-year period immediately preceding the bid submittal deadline for this project. Similar size is defined as a minimum of 70 percent of the bid amount submitted by the Bidder.

A. Capacity

- i. Gross dollar amount of work currently under contract:

- ii. Gross dollar amount of contracts currently not completed:

- iii. List five major pieces of equipment which are anticipated to be used on this project by the Contractor and note which items are owned by the Contractor and which are to be leased or rented from others:

- iv. Number of superintendents on Bidder's staff:

B. Experience

i. General character of work performed by firm:

ii. Identify who will be the superintendent on this project and years of experience.
Also, list the number of years this person has been with your firm.

iii. Identify who will be the superintendent on this project and years of experience.
Also, list the number of years this person has been with your firm.

iv. Similar Size and Scope Projects Completed in the Past 5 Years

#1 Owner's Name and Contact Information:

Owner is a Government Agency? ___Yes ___No

Superintendent's Name:

Project Name:

Awarded Contract Amount:

Final Contract Amount:

Completion Date:

Project Description:

#2 Owner's Name and Contact Information:

Owner is a Government Agency? ___Yes ___No

Superintendent's Name:

Project Name:

Awarded Contract Amount:

Final Contract Amount:

Completion Date:

Project Description:

#2 Owner's Name and Contact Information:

Owner is a Government Agency? ___Yes ___No

Superintendent's Name:

Project Name:

Awarded Contract Amount:

Final Contract Amount:

Completion Date:

Project Description:

This page intentionally left blank.

APPENDIX B - CONTRACT PLANS

This page intentionally left blank.

Plotted By: Allen, Erik. Sheet Set: Canal View Water System Improvements. Layout: COVER SHEET. WMR. July 28, 2026 12:21:20pm K:\SNO_PublicSet\090070002 MPUD Canal View\2 - CADD\PlotSheets\G-SITE_GENERAL.dwg
This document, together with the concepts and design presented herein, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and approval by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.




MASON COUNTY PUBLIC UTILITY DISTRICT NO. 1

CANAL VIEW MAINLINE IMPROVEMENTS

JULY 2026

SHEET LIST TABLE

SHEET	SHEET TITLE
G.01	COVER SHEET
G.02	GENERAL NOTES
EC.01	TESC NOTES
W.01	DISTRIBUTION PLANS - 1
W.02	DISTRIBUTION PLANS - 2
W.03	DISTRIBUTION PLANS - 3
W.04	DISTRIBUTION PLANS - 4
D.01	WATER DETAILS

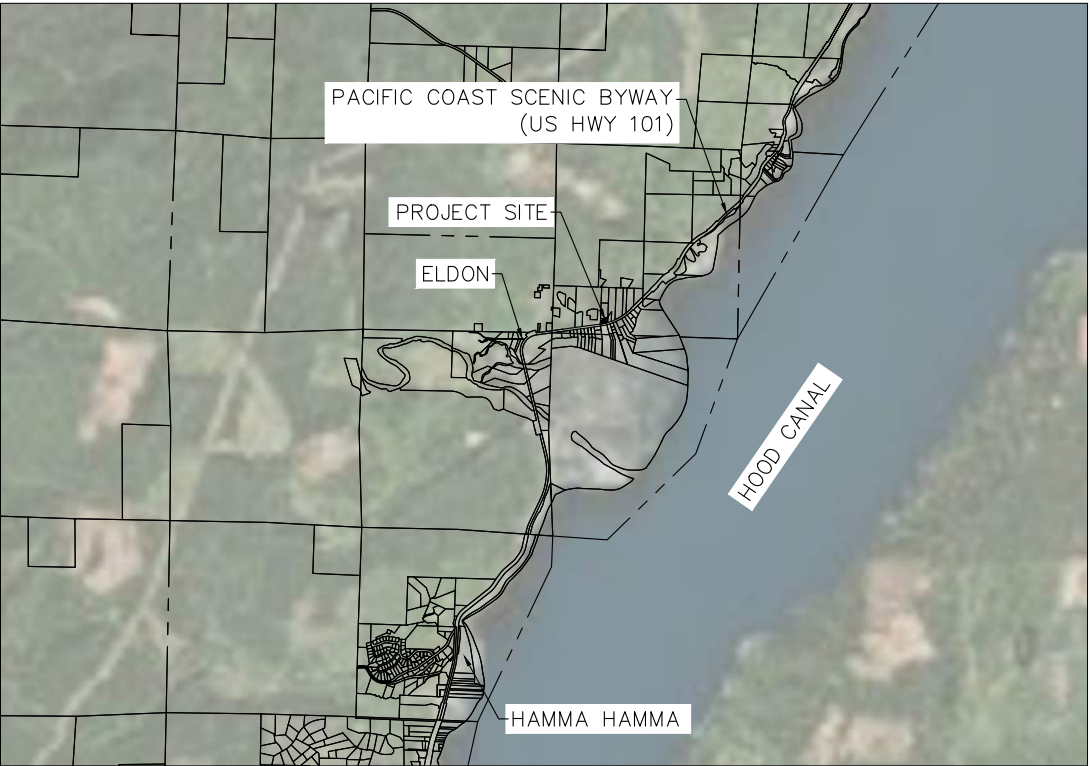

VICINITY MAP
NOT TO SCALE



PUD OFFICIALS:

MIKE SHEETZ
DISTRICT 1 COMMISSIONER

RON GOLD
DISTRICT 2 COMMISSIONER

JACK JANDA
DISTRICT 3 COMMISSIONER

PROJECT DATA:

MASON COUNTY PUD NO.1 (OWNER)
BRANDY MILROY
WATER RESOURCE MANAGER
N21971 HWY 101
SHELTON, WA 98584
360-877-5249
BRANDYM@MASON-PUD1.ORG

WHITEWOLF ENGINEERING SERVICES (PROJECT MANAGEMENT)
RAVYN WHITEWOLF, PE, PMP, VMA
360-592-3445
WHITEWOLFENGINEERINGSERVICES@GMAIL.COM

KIMLEY-HORN AND ASSOCIATES (DESIGNER)
SARA TANNAHILL, PE
2828 COLBY AVE SUITE 200, EVERETT, WA 98201
206-970-1903
SARA.TANNAHILL@KIMLEY-HORN.COM

BY:
Kimley»Horn

© 2026 KIMLEY-HORN AND ASSOCIATES, INC.



Know what's below.
Call before you dig.




07/28/2026



G.01

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.


- This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.



KHA PROJECT 090070002	DATE 7/28/2026	SCALE AS SHOWN	DESIGNED BY ETA	DRAWN BY ETA	CHECKED BY SMT
TESC NOTES					
CANAL VIEW MAINLINE IMPROVEMENTS PREPARED FOR MASON COUNTY PUD#1 MASON COUNTY WASHINGTON					
SHEET NUMBER EC.01					

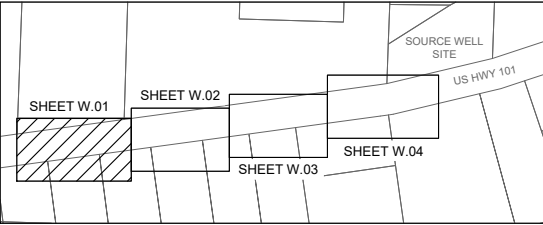

KEY MAP
NOT TO SCALE

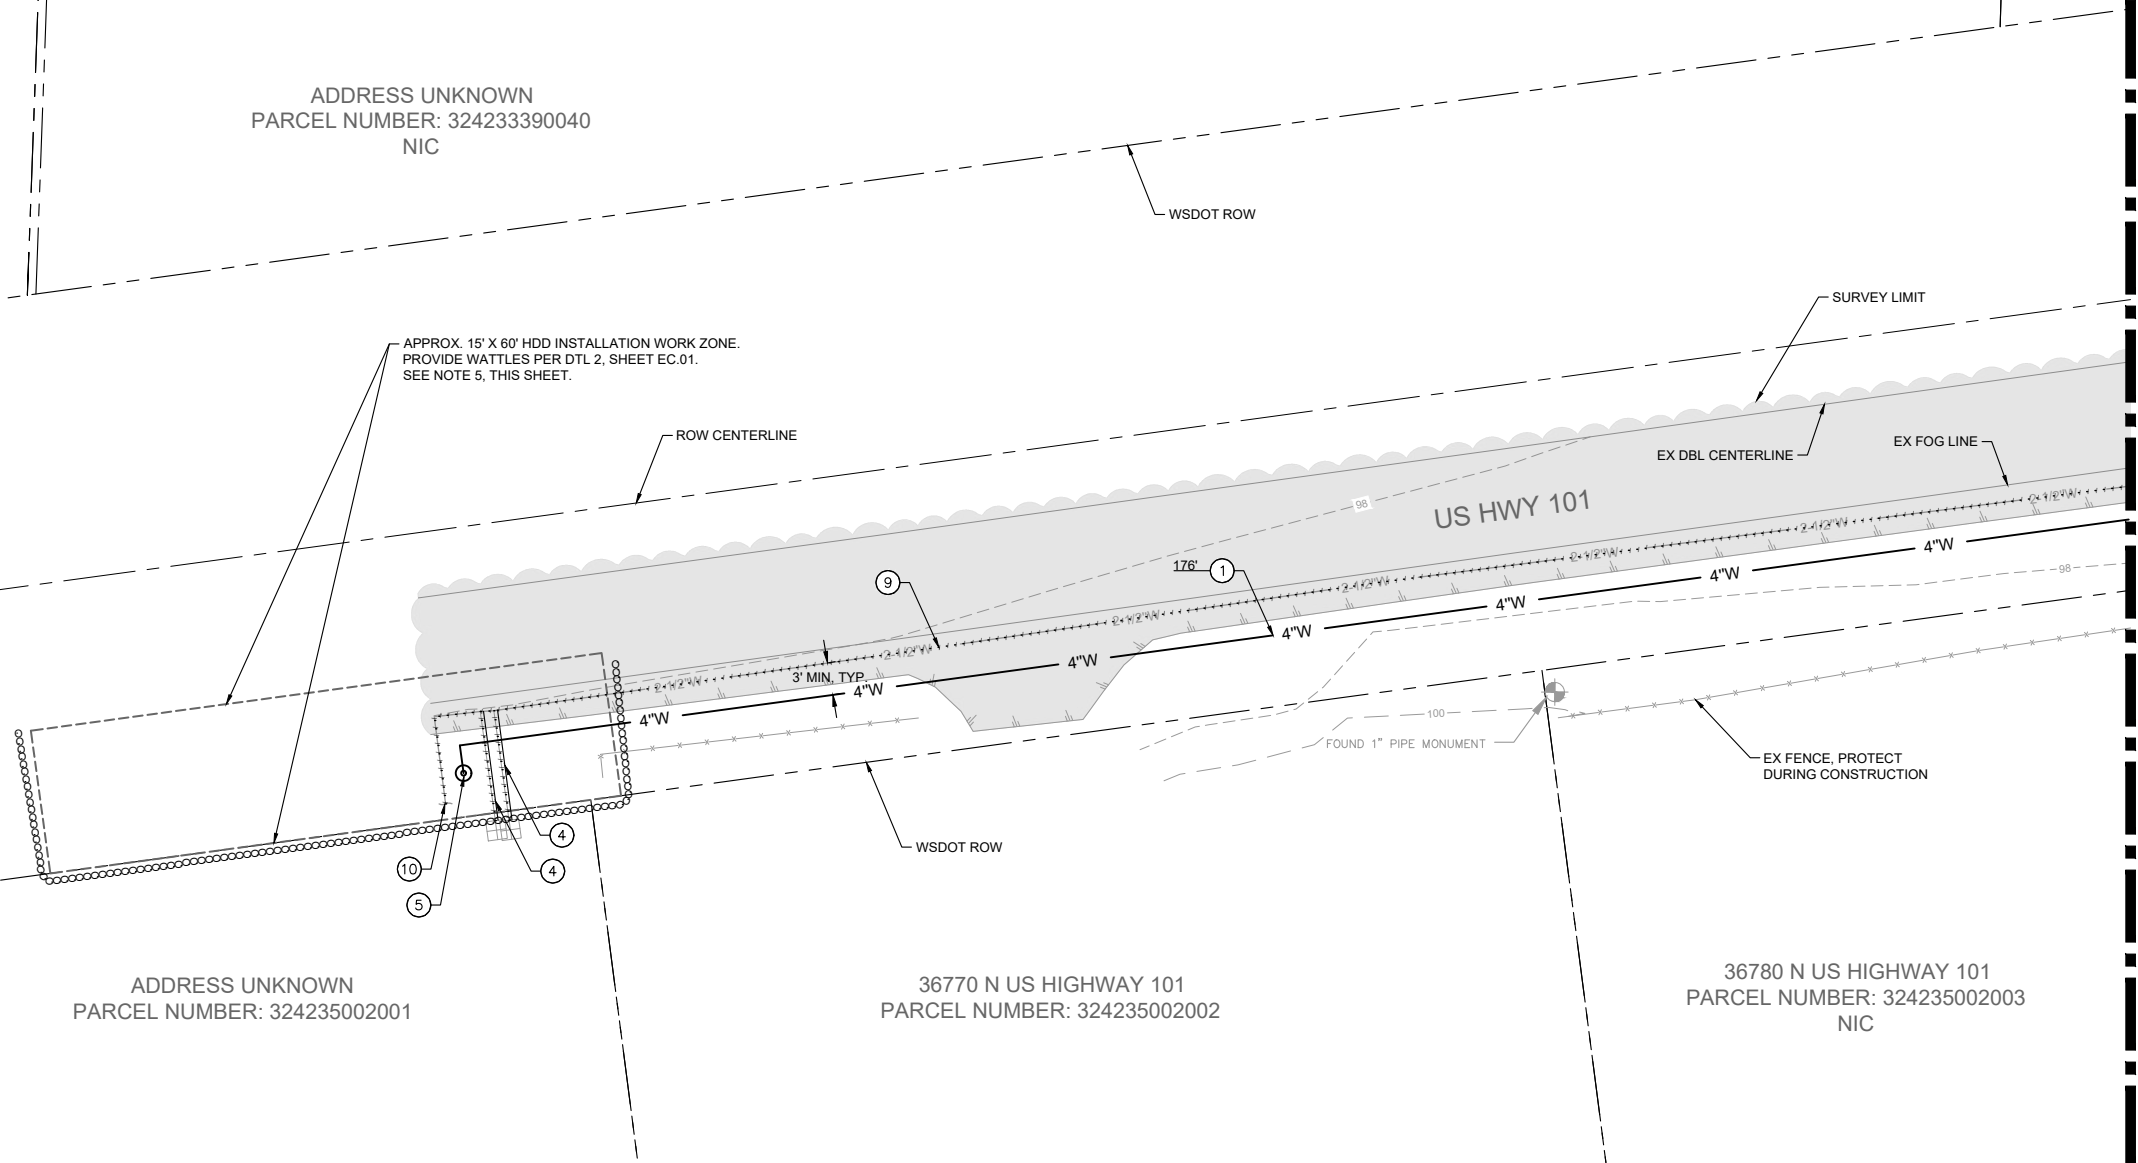

WATER NOTES:

1. INSTALL 4" SDR11 HDPE WATER MAIN, BUTT FUSED, VIA HDD BORING. MIN COVER 6". SEE NOTE 2, THIS SHT.
4. INSTALL NEW SERVICE CONNECTION PER DTL 5/D.01. CURB STOP SHALL BE LOCATED WITHIN 5' OF EX METER. METER CONNECTION TO BE MADE BY MPUD NO.1 ONCE SYSTEM HAS BEEN TESTED AND APPROVED. PROVIDE WATTLES AS NEEDED FOR EROSION AND SEDIMENTATION CONTROL.
5. INSTALL BLOW OFF VALVE ASSEMBLY AT END OF 4" WATER MAIN PER DTL 3/D.01.
9. ABANDON EXISTING 2.5" PVC WATER MAIN AND APPURTENANCES PER WSDOT UTILITIES MANUAL (M 22-87).
10. EXISTING BLOW OFF VALVE, PROTECT DURING CONSTRUCTION. DISTRICT TO REMOVE EXISTING BLOW OFF FOLLOWING CONSTRUCTION.

SHEET NOTES

1. EXISTING TREES ON PROJECT SITE NOT SHOWN. CONTRACTOR TO PROTECT TREE ROOTS DURING WATER MAIN INSTALLATION.
2. WATERLINE SHALL BE INSTALLED AT A CONTINUOUSLY RISING SLOPE FROM THE CANAL VIEW WELL SITE CONNECTION TO THE BLOW-OFF. ANY INTERMEDIATE HIGHPOINTS WILL REQUIRE AN AIR/VAC VALVE.
3. EXISTING SITE YARD PIPING NOT SURVEYED. DIGITIZED PER DISTRICT RECORDS. ALL EXISTING UTILITIES AND CONNECTION POINTS WITHIN THE PROJECT LIMITS SHALL BE POTHOLED PRIOR TO WATER MAIN CONSTRUCTION. NOTIFY MPUD AND THE ENGINEER IMMEDIATELY IF DISCREPANCIES ARE FOUND.
4. EXISTING 2.5" PVC W SHALL BE POTHOLED PRIOR TO INSTALLATION, NOTIFY THE ENGINEER IMMEDIATELY IF EXISTING LINE CONFLICTS WITH PROPOSED CASING OR MAIN.
5. AREAS DISTURBED BY CONSTRUCTION SHALL BE RESTORED TO MATCH EXISTING CONDITIONS ONCE WATER MAIN CONSTRUCTION IS COMPLETE.
 - 5.1. ALL BACKFILL WITHIN WSDOT ROW FOR EXCAVATIONS SHALL CONSIST OF CSTC PER SECTION 9-03.9(3) OF WSDOT STANDARD SPECIFICATIONS. CSTC SHALL BE COMPACTED TO 95% MAX DRY DENSITY.
 - 5.2. RESTORATION IN PERVIOUS AREAS SHALL CONSIST OF A MINIMUM PLACED DEPTH OF 6-IN TOPSOIL WITH HYDROSEEDING, BOTH PER SECTION 8-02 OF THE WSDOT STANDARD SPECIFICATIONS.
 - 5.3. PAVED AREAS DISTURBED DURING CONSTRUCTION SHALL HAVE CLEAN EDGES SAWCUT AND PERMANENT TRENCH PATCH PLACED PER SECTION 5-04 OF THE WSDOT STANDARD SPECIFICATIONS. HMA SHALL BE PLACED TO EITHER 8-IN COMPACTED DEPTH OR THE THICKNESS OF THE EXISTING PAVEMENT SECTION WHICHEVER IS GREATER.
 - 5.4. STRIPING DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO MATCH EXISTING CONDITIONS PER SECTION 8-22 OF THE WSDOT STANDARD SPECIFICATIONS.
 - 5.5. SEE DTL 6, SHEET D.01 FOR A STANDARD RESTORATION SECTION.

Kimley»Horn
© 2026 KIMLEY-HORN AND ASSOCIATES, INC.
WWW.KIMLEY-HORN.COM PHONE: 425-708-8275
2828 COLBY AVENUE, SUITE 200, EVERETT, WA 98201






KHA PROJECT	DATE	SCALE	DESIGNED BY	ETA	CHECKED BY	SMT
090070002	7/28/2026	AS SHOWN	ETA	ETA		

DISTRIBUTION
PLANS - 1

CANAL VIEW MAINLINE
IMPROVEMENTS
PREPARED FOR
MASON COUNTY PUD#1
WASHINGTON
MASON COUNTY

SHEET NUMBER
W.01

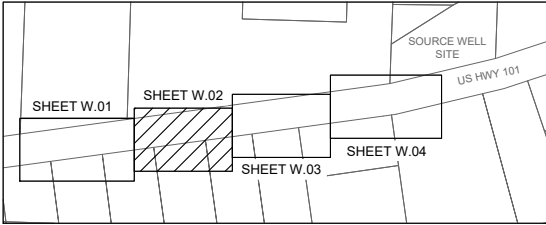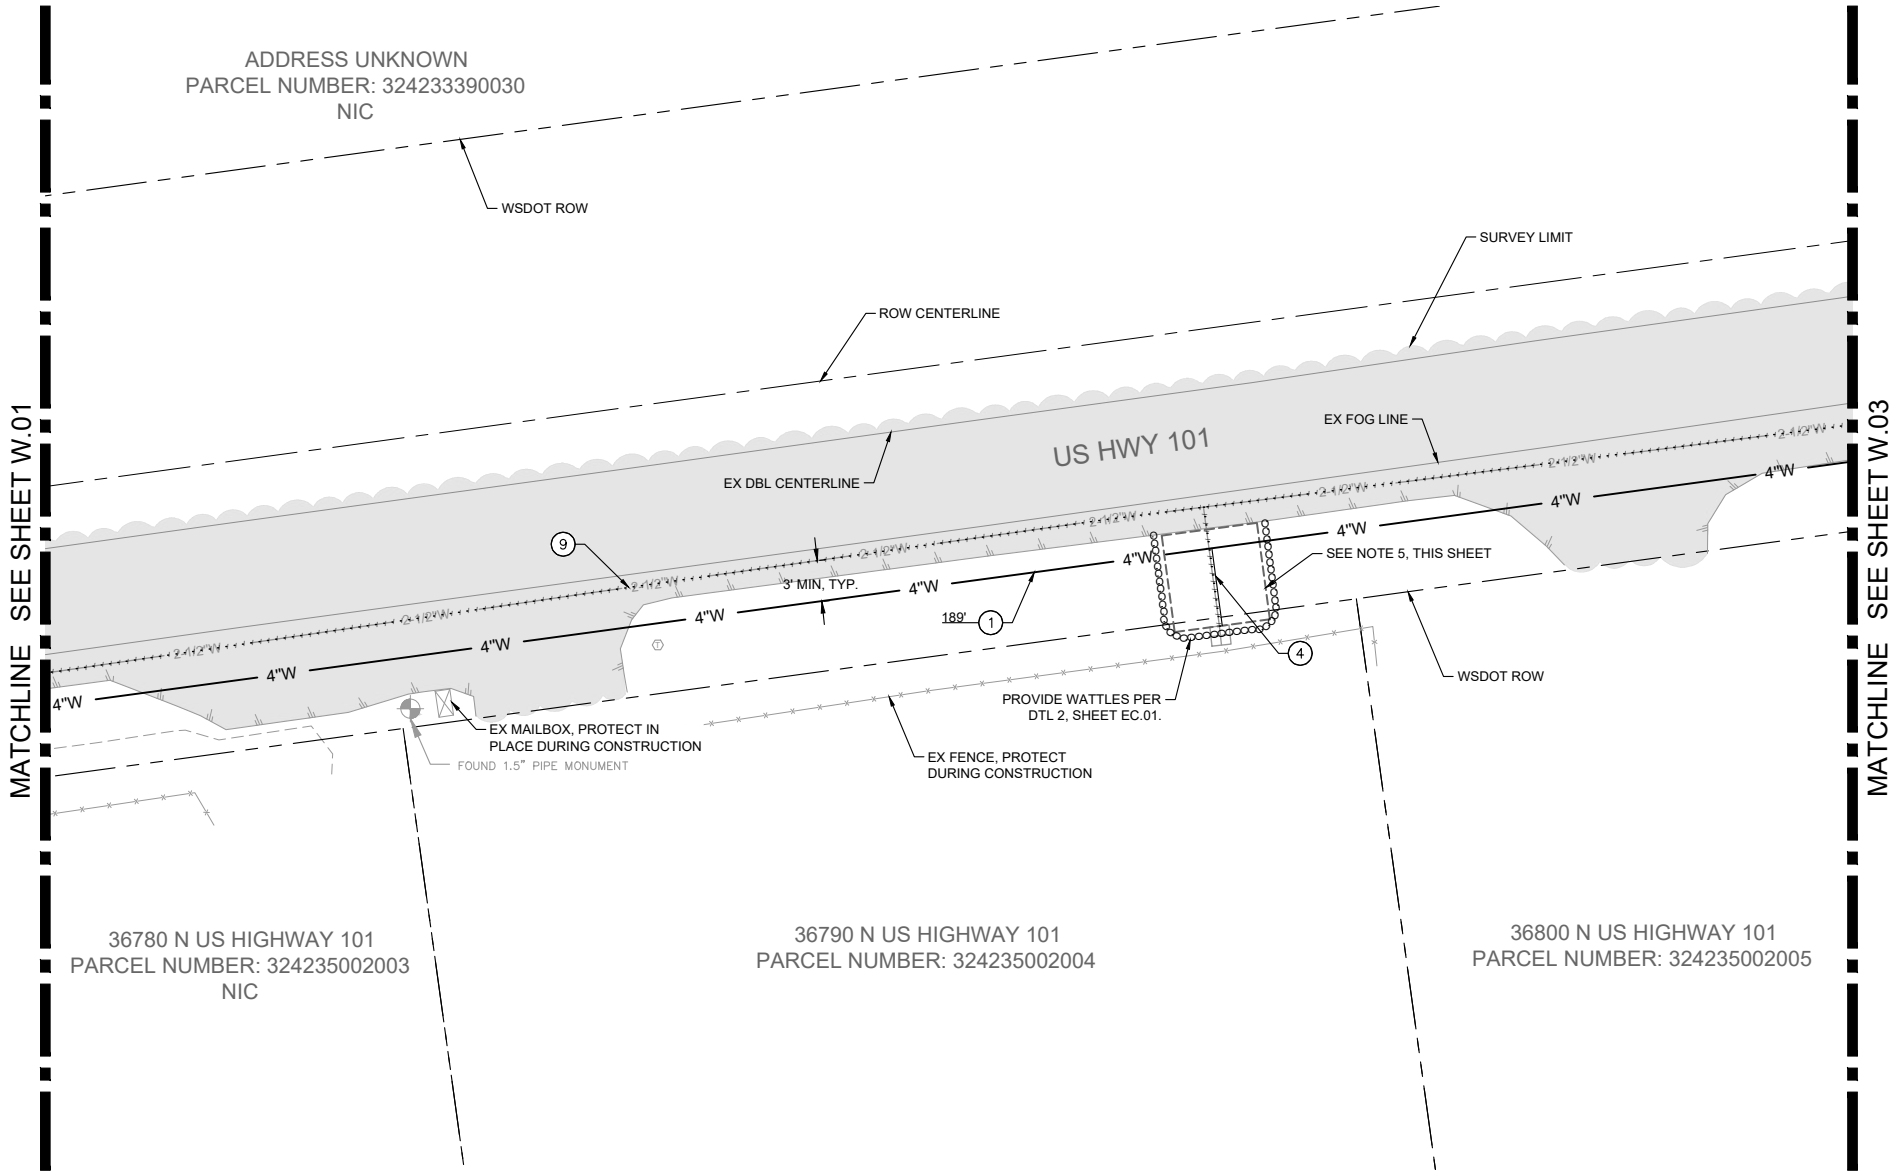

KEY MAP
NOT TO SCALE

WATER NOTES:

1. INSTALL 4" SDR11 HDPE WATER MAIN, BUTT FUSED, VIA HDD BORING. MIN COVER 6". SEE NOTE 2, THIS SHT.
4. INSTALL NEW SERVICE CONNECTION PER DTL 5/D.01. CURB STOP SHALL BE LOCATED WITHIN 5' OF EX METER. METER CONNECTION TO BE MADE BY MPUD NO.1 ONCE SYSTEM HAS BEEN TESTED AND APPROVED. PROVIDE WATTLES AS NEEDED FOR EROSION AND SEDIMENTATION CONTROL.
9. ABANDON EXISTING 2.5" PVC WATER MAIN AND APPURTENANCES PER WSDOT UTILITIES MANUAL (M 22-87).

SHEET NOTES

1. EXISTING TREES ON PROJECT SITE NOT SHOWN. CONTRACTOR TO PROTECT TREE ROOTS DURING WATER MAIN INSTALLATION.
2. WATERLINE SHALL BE INSTALLED AT A CONTINUOUSLY RISING SLOPE FROM THE CANAL VIEW WELL SITE CONNECTION TO THE BLOW-OFF. ANY INTERMEDIATE HIGHPOINTS WILL REQUIRE AN AIR/VAC VALVE.
3. EXISTING SITE YARD PIPING NOT SURVEYED. DIGITIZED PER DISTRICT RECORDS. ALL EXISTING UTILITIES AND CONNECTION POINTS WITHIN THE PROJECT LIMITS SHALL BE POTHOLED PRIOR TO WATER MAIN CONSTRUCTION. NOTIFY MPUD AND THE ENGINEER IMMEDIATELY IF DISCREPANCIES ARE FOUND.
4. EXISTING 2.5" PVC W SHALL BE POTHOLED PRIOR TO INSTALLATION. NOTIFY THE ENGINEER IMMEDIATELY IF EXISTING LINE CONFLICTS WITH PROPOSED CASING OR MAIN.
5. AREAS DISTURBED BY CONSTRUCTION SHALL BE RESTORED TO MATCH EXISTING CONDITIONS ONCE WATER MAIN CONSTRUCTION IS COMPLETE.
 - 5.1. ALL BACKFILL WITHIN WSDOT ROW FOR EXCAVATIONS SHALL CONSIST OF CSTC PER SECTION 9-03.9(3) OF WSDOT STANDARD SPECIFICATIONS. CSTC SHALL BE COMPACTED TO 95% MAX DRY DENSITY.
 - 5.2. RESTORATION IN PERVIOUS AREAS SHALL CONSIST OF A MINIMUM PLACED DEPTH OF 6-IN TOPSOIL WITH HYDROSEEDING, BOTH PER SECTION 8-02 OF THE WSDOT STANDARD SPECIFICATIONS.
 - 5.3. PAVED AREAS DISTURBED DURING CONSTRUCTION SHALL HAVE CLEAN EDGES SAWCUT AND PERMANENT TRENCH PATCH PLACED PER SECTION 5-04 OF THE WSDOT STANDARD SPECIFICATIONS. HMA SHALL BE PLACED TO EITHER 8-IN COMPACTED DEPTH OR THE THICKNESS OF THE EXISTING PAVEMENT SECTION WHICHEVER IS GREATER.
 - 5.4. STRIPING DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO MATCH EXISTING CONDITIONS PER SECTION 8-22 OF THE WSDOT STANDARD SPECIFICATIONS.
 - 5.5. SEE DTL 6, SHEET D.01 FOR A STANDARD RESTORATION SECTION.

No.	REVISIONS	DATE	BY

Kimley»Horn

© 2026 KIMLEY-HORN AND ASSOCIATES, INC.
WWW.KIMLEY-HORN.COM PHONE: 425-708-8275
2828 COLBY AVENUE, SUITE 200, EVERETT, WA 98201



KHA PROJECT	DATE	SCALE	DESIGNED BY	DRAWN BY	CHECKED BY
090070002	7/28/2026	AS SHOWN	GTC	ETA	SMT



DISTRIBUTION
PLANS - 2

CANAL VIEW MAINLINE
IMPROVEMENTS
PREPARED FOR
MASON COUNTY PUD#1

MASON COUNTY
WASHINGTON

SHEET NUMBER
W.02

Plotted by Allen Erik Seidel Canal Water System Improvements Layout DISTRIBUTION 3 July 28, 2026 12:21:30pm K:\SNO_Produ_Sector0500770002 MPUD Canal View2 - CADD\DrawSheets\C-DISTRIBUTION.dwg
This document, together with the concepts and designs presented herein, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.



ADDRESS UNKNOWN
PARCEL NUMBER: 324235001003



SECTION VIEW
US HWY 101 - WATER CROSSING



- ① INSTALL 4" SDR11 HDPE WATER MAIN, BUTT FUSED, VIA HDD BORING. MIN COVER 6'. SEE NOTE 2, THIS SHT.
- ② INSTALL 4" SDR11 HDPE WATER MAIN, BUTT FUSED, W/ CASING SPACERS. ONCE WATER MAIN TESTING APPROVED BY DISTRICT FILL ANNUAL CASING SPACE WITH NON-SHRINK GROUT AND INSTALL FLEXIBLE BOOT SEALS.
- ③ INSTALL:
12" DIAM. 1/2" THICKNESS ASTM A252 GRADE 2 STEEL CASING PIPE COATED W/ BITUMINIOUS ASPHALT COATING
OR
SDR9 HDPE CASING
PERPENDICULAR TO ROAD PER WSDOT UTILITIES MANUAL (M 22-87).
- ④ INSTALL NEW SERVICE CONNECTION PER DTL 5/D.01. CURB STOP SHALL BE LOCATED WITHIN 5' OF EX METER. METER CONNECTION TO BE MADE BY MPUD NO.1 ONCE SYSTEM HAS BEEN TESTED AND APPROVED. PROVIDE WATTLES AS NEEDED FOR EROSION AND SEDIMENTATION CONTROL.
- ⑤ INSTALL:
1-4" DI TEE, FL.
1-4" DI GATE VALVE, FL. PER DETAIL 2 AND 4/D.01
2-4" SDR11 HDPE ADAPTER, BUTT FUSED x FL. W/ BACKING RING.
1-4" DI BLIND FLANGE
- ⑦ INSTALL 4" SDR11 HDPE WATER MAIN, BUTT FUSED. MIN COVER IN WSDOT ROW 6'.
- ⑨ ABANDON EXISTING 2.5" PVC WATER MAIN AND APPURTENANCES PER WSDOT UTILITIES MANUAL (M 22-87).

1. EXISTING TREES ON PROJECT SITE NOT SHOWN, CONTRACTOR TO PROTECT TREE ROOTS DURING WATER MAIN INSTALLATION.
2. WATERLINE SHALL BE INSTALLED AT A CONTINUOUSLY RISING SLOPE FROM THE CANAL VIEW WELL SITE CONNECTION TO THE BLOW-OFF. ANY INTERMEDIATE HIGHPOINTS WILL REQUIRE AN AIR/VAC VALVE.
3. EXISTING SITE YARD PIPING NOT SURVEYED. DIGITIZED PER DISTRICT RECORDS. ALL EXISTING UTILITIES AND CONNECTION POINTS WITHIN THE PROJECT LIMITS SHALL BE POTHOLED PRIOR TO WATER MAIN CONSTRUCTION. NOTIFY MPUD AND THE ENGINEER IMMEDIATELY IF DISCREPANCIES ARE FOUND.
4. EXISTING 2.5" PVC W/ SHALL BE POTHOLED PRIOR TO INSTALLATION, NOTIFY THE ENGINEER IMMEDIATELY IF EXISTING LINE CONFLICTS WITH PROPOSED CASING OR MAIN.
5. AREAS DISTURBED BY CONSTRUCTION SHALL BE RESTORED TO MATCH EXISTING CONDITIONS ONCE WATER MAIN CONSTRUCTION IS COMPLETE.
- 5.1. ALL BACKFILL WITHIN WSDOT ROW FOR EXCAVATIONS SHALL CONSIST OF CSTC PER SECTION 9-03.9(3) OF WSDOT STANDARD SPECIFICATIONS. CSTC SHALL BE COMPACTED TO 95% MAX DRY DENSITY.
- 5.2. RESTORATION IN PERVIOUS AREAS SHALL CONSIST OF A MINIMUM PLACED DEPTH OF 6-IN TOPSOIL WITH HYDROSEEDING, BOTH PER SECTION 8-02 OF THE WSDOT STANDARD SPECIFICATIONS.
- 5.3. PAVED AREAS DISTURBED DURING CONSTRUCTION SHALL HAVE CLEAN EDGES SAWCUT AND PERMANENT TRENCH PATCH PLACED PER SECTION 5-04 OF THE WSDOT STANDARD SPECIFICATIONS. HMA SHALL BE PLACED TO EITHER 8-IN COMPACTED DEPTH OR THE THICKNESS OF THE EXISTING PAVEMENT SECTION WHICHEVER IS GREATER.
- 5.4. STRIPING DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO MATCH EXISTING CONDITIONS PER SECTION 8-22 OF THE WSDOT STANDARD SPECIFICATIONS.
- 5.5. SEE DTL 6, SHEET D.01 FOR A STANDARD RESTORATION SECTION.

Kimley»Horn
© 2026 KIMLEY-HORN AND ASSOCIATES, INC.
WWW.KIMLEY-HORN.COM PHONE: 425-708-9275
2828 COLBY AVENUE, SUITE 200, EVERETT, WA 98201






KHA PROJECT 090070002	DATE 7/28/2026	SCALE AS SHOWN	DESIGNED BY ETA	DRAWN BY ETA	CHECKED BY SMT
--------------------------	-------------------	----------------	-----------------	--------------	----------------

DISTRIBUTION PLANS - 4

CANAL VIEW MAINLINE
IMPROVEMENTS
PREPARED FOR
MASON COUNTY PUD#1
MASON COUNTY WASHINGTON

SHEET NUMBER
W.04



This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc., shall be without liability to Kimley-Horn and Associates, Inc.

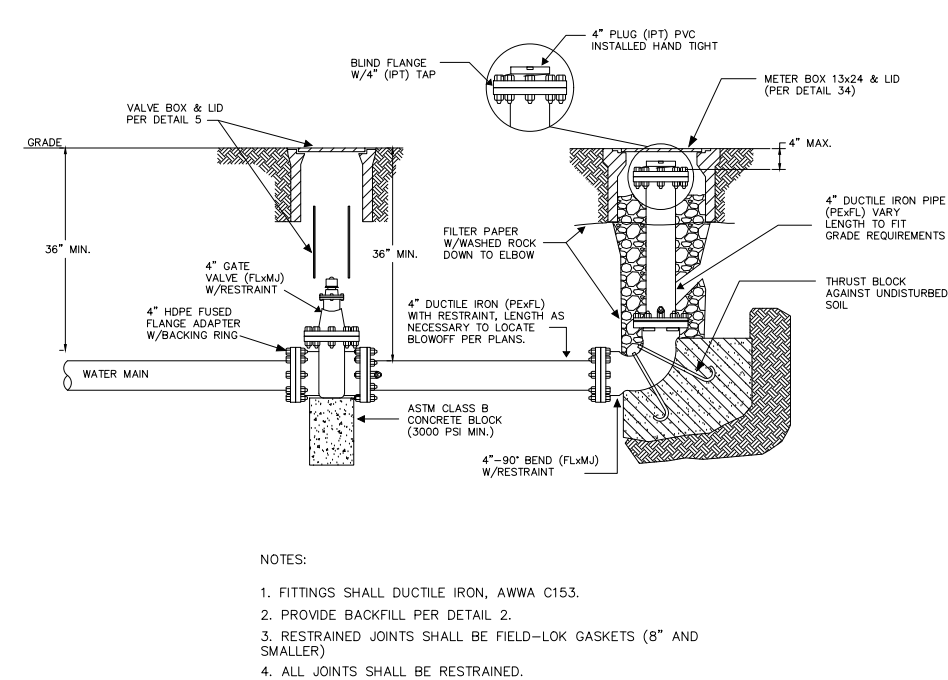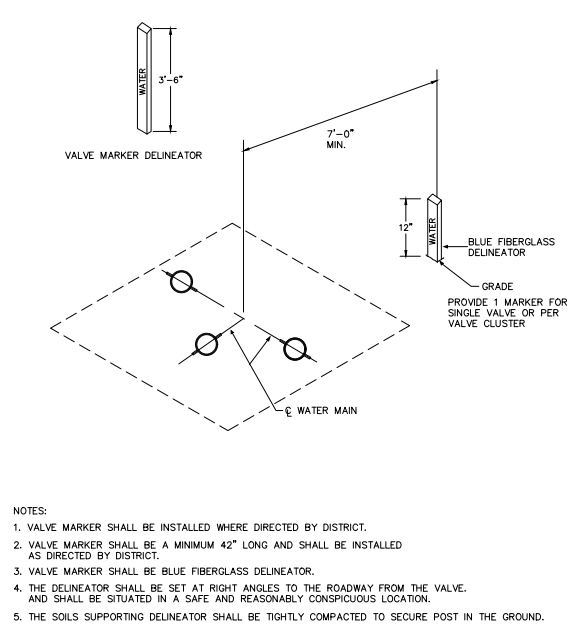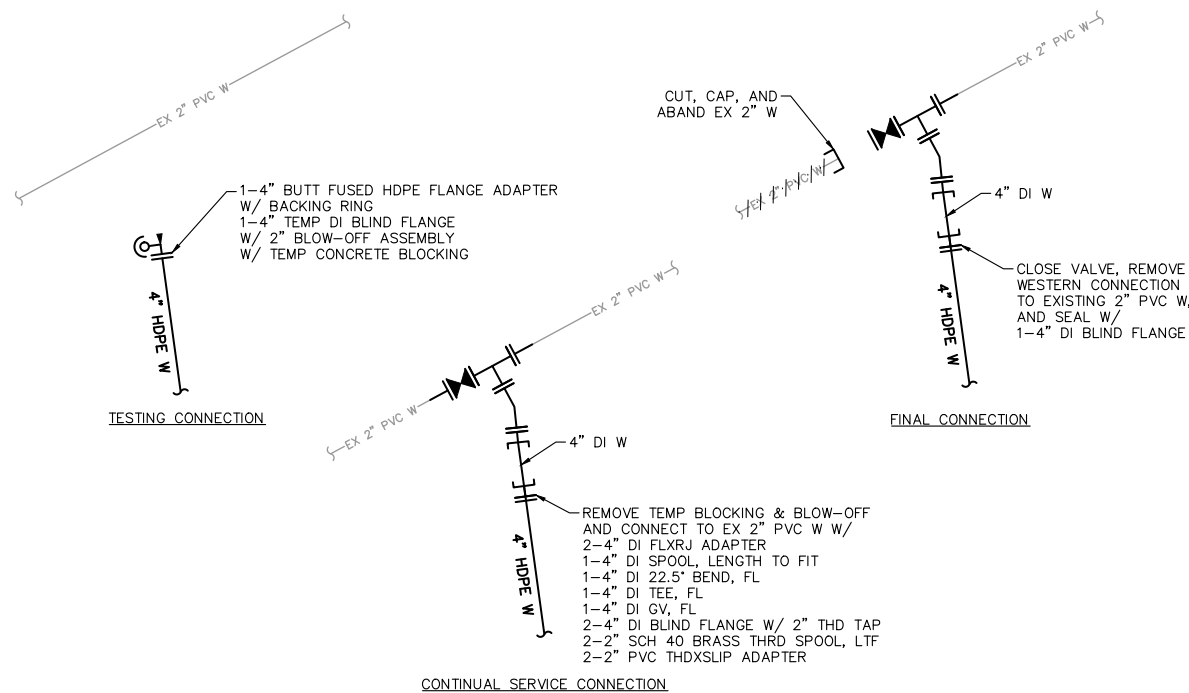

1
W.04

EX YARD PIPING
CONNECTION DETAIL


NTS

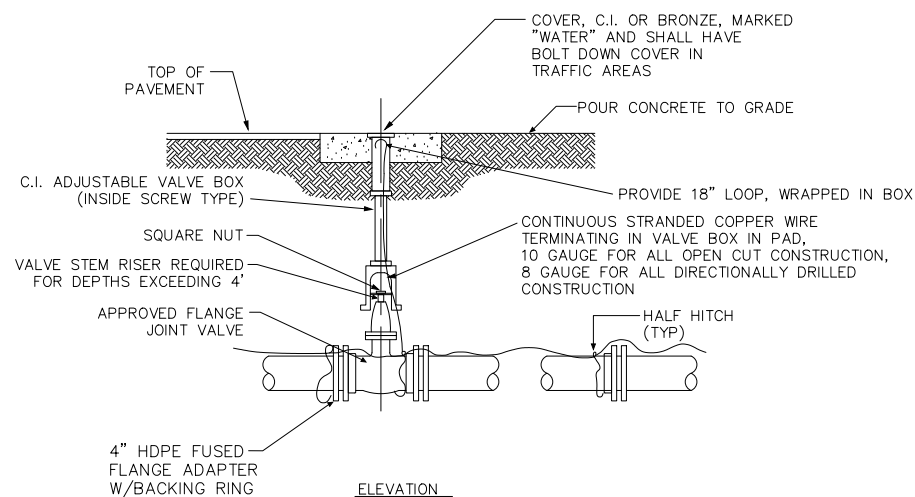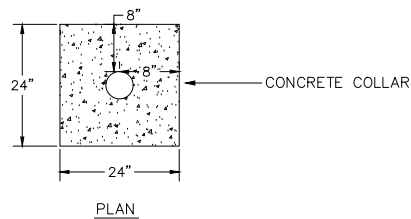

MPUD MODIFIED DETAIL
VALVE SETTING

4
-- NTS

MPUD STANDARD DETAIL
VALVE MARKER

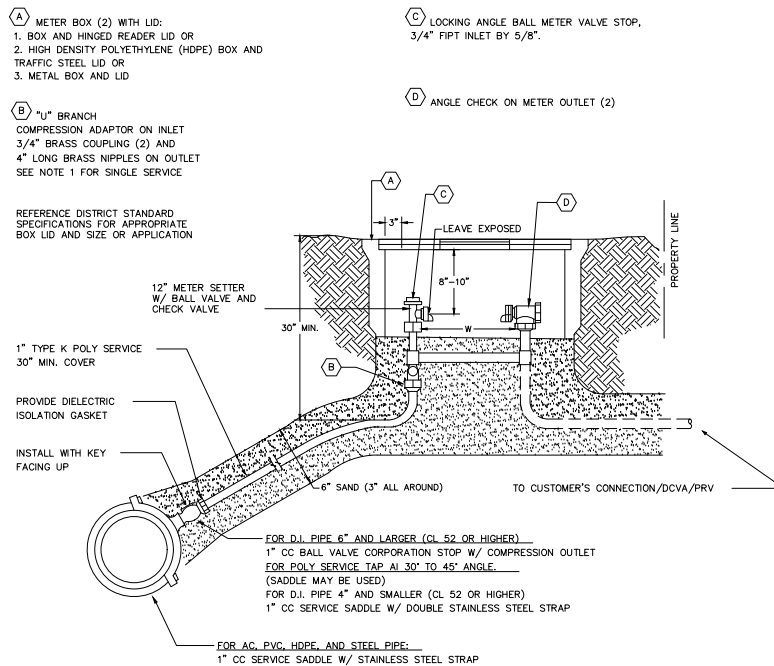


- NOTES:
1. THIS DETAIL IS FOR TYPICAL DUAL-METER SERVICES. FOR SINGLE SERVICE, CONNECT POLY DIRECTLY TO METER SETTER.
 2. CONTRACTOR/DEVELOPER SHALL MAKE APPLICATION FOR METER WITH DISTRICT. WATER METER TO BE PURCHASED FROM DISTRICT.
 3. METER BOX SHALL BE INSTALLED FLUSH WITH FINAL GRADE (TOP OF SIDEWALK, ASPHALT, SHOULDER, OR CURB) AND MUST BE SIZED TO ALLOW FOR MIN. CLEARANCE REQUIREMENTS.
 4. 1" SERVICE LINE SHALL NOT EXCEED 50' UNLESS APPROVED BY DISTRICT ENGINEER.
 5. USE METAL BOX LID IN VEHICULAR TRAVEL AREA OR WITHIN 1' FROM DRIVEWAY WITHOUT SIDEWALK. USE HDPE BOX WITH TRAFFIC STEEL LID AS DIRECTED BY DISTRICT ENGINEER.

MPUD STANDARD DETAIL
WATER METER

5
-- NTS

MPUD MODIFIED DETAIL
END OF MAIN BLOWOFF ASSEMBLY

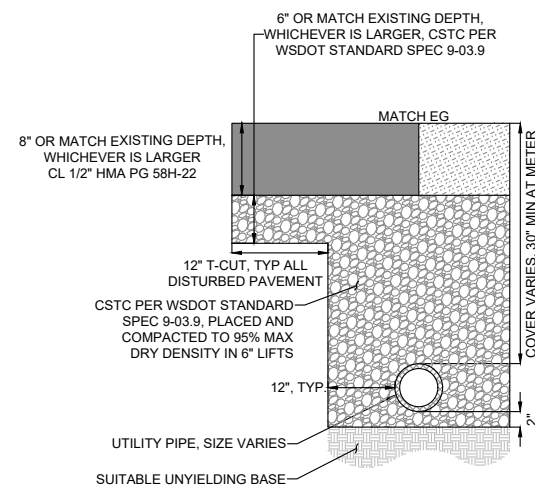

WSDOT ROW
RESTORATION SECTION

[illegible]

Kimley»»Horn
© 2026 KIMLEY-HORN AND ASSOCIATES, INC.
WWW.KIMLEY-HORN.COM PHONE: 425-708-8275
2828 COLBY AVENUE, SUITE 200, EVERETT, WA 98201



KHA PROJECT 090070002	DATE 7/28/2026	SCALE AS SHOWN	DESIGNED BY ETA	DRAWN BY ETA	CHECKED BY SMT
--------------------------	-------------------	----------------	-----------------	--------------	----------------

WATER DETAILS

CANAL VIEW MAINLINE
IMPROVEMENTS
PREPARED FOR
MASON COUNTY PUD#1
MASON COUNTY WASHINGTON

SHEET NUMBER
D.01